

## EY-IO 571: I/O module, digital inputs/outputs (open collector), modu571

### How energy efficiency is improved

SAUTER EY-modulo 5 technology: modular, fast and universal

### Features

- Part of the SAUTER EY-modulo 5 system family
- 16 digital inputs and outputs
- Plug-in element for extending the modu525 automation station (AS)
- Modular design (baseplate/electronics)
- Power supply from modu525 AS
- Direct labelling on the front
- Can be equipped with a local operating and indicating unit



EY-IO571F001

### Technical data

#### Power supply

Power supply	From modu525 AS via I/O bus
Power consumption <sup>1)</sup>	≤ 1 VA/0.4 W
Power loss	≤ 0.4 W
Current consumption <sup>2)</sup>	≤ 25 mA

#### Ambient conditions

Operating temperature	0...45 °C
Storage and transport temperature	-25...70 °C
Admissible ambient humidity	10...85% rh, no condensation

#### Inputs/Outputs

Digital inputs/outputs	16
Type of inputs/outputs	Open collector, NO contacts (0-I), outputs switched with respect to ground (any arrangement)
Power supply for DO	External, positive ≤ 24 V=
Load	0 mA up to 100 mA
Power supply for DI	internal, 13.5 V
Pulse counter	(DI) ≤ 10 Hz

#### Interfaces and communication

Connection for modu6**	6-pin, integrated
Connection, I/O bus	12-pin, integrated
Connection terminals	24 (0.5...2.5 mm <sup>2</sup> )

#### Construction

Fitting	On top-hat rail
Dimensions W x H x D	42 × 170 × 115 mm
Weight	0.29 kg

#### Standards and directives

Type of protection	IP 30 (EN 60529)
Protection class	I (EN 60730-1)
Environment class	3K3 (IEC 60721)

CE conformity as per	EMC directive 2004/108/EC <sup>3)</sup>	EN 61000-6-1, EN 61000-6-2, EN 61000-6-3, EN 61000-6-4
----------------------	-----------------------------------------	--------------------------------------------------------

#### Overview of types

Type	Properties
EY-IO571F001	I/O module, digital inputs/outputs (open collector), modu571

<sup>1)</sup> On the primary side of modu525 base station (230 V~)

<sup>2)</sup> Supply via modu525 base station

<sup>3)</sup> EN 61000-6-2: In order to meet the European standard, the power cable should not exceed 30 metres in length.



## Accessories

### Local operating and indicating units (LOI)

Type	Description
EY-LO630F001	16-LED indication, bi-colour
EY-LO650F001	6 switches, auto-0-I, 4 LEDs operation/indication
EY-LO650F002	3 switches, auto-0-I-II, 4 LEDs operation/indication

### Components

Type	Description
0920360003	24 V I/O module baseplate (pack of 3)
0929360571	Electronics module, modu571, 16 DI/DO (OC) 24 V

### Description of operation

Recording of digital inputs (alarm/status) and activation of actuators such as relays or displays of operational systems, e.g. in HVAC engineering.

The I/O module has a total of 16 digital inputs and digital outputs freely available.

Each hardware connection can be defined individually as an input (DI) or output (DO) using software parameters; only one function is possible at a time.

### Intended use

This product is only suitable for the purpose intended by the manufacturer, as described in the "Description of operation" section.

All related product documents must also be adhered to. Changing or converting the product is not admissible.

### Engineering notes

The modu571 I/O module is generally comprised of two components. The baseplate in which the I/O bus system and the connection terminals are integrated and the actual I/O module electronics.

### Fitting/assembly

The baseplate of the I/O module is mounted in a cabinet using a top-hat rail (EN 60715) and connected on the side directly to the I/O bus of the modu525 AS or modules. This work must only be carried out in the de-energised state.

To guarantee an optimum ground connection, we recommend connecting one ground terminal of the I/O module directly with the AS or each appropriate cabinet terminal.

The baseplate contains a "bus module", which is responsible for power supply and continuous communication as well as the optional emergency power supply. This ensures that faults due to a failure or partial defect in the electronic component do not affect the function of other downstream modules. Removing/inserting the I/O module electronics from/to the baseplate is possible while the AS is in operation.

To ensure plant safety and to avoid any faults at inputs or outputs, the I/O module electronics should only be removed or inserted while the base station is switched off.

### Labelling concept

The I/O module can be labelled with a paper insert in the frontal transparent cap. The labelling is usually carried out using texts generated from CASE Suite, and the labels are printed on normal A4 paper using a commercial printer.

### Assigning modules to AS

The I/O module electronics are encoded on the hardware side using pin inserts so that only the appropriate baseplate can be used. The modu525 AS detects whether a module baseplate is plugged into the I/O bus. Baseplate number and assignment of module types for the I/O modules on the AS are defined with CASE Suite. This information is permanently stored in the AS.

### LED indicator/function

The I/O module is equipped with a system LED that indicates the operating modes as follows:

## System LED

LED I/O bus	Status	Indicator sequence	Description
No designation	Continuous green	—————	Module in operation
	Pulsating green	o o o o o	Module not assigned with the base station
	Rapid pulsating red	oooooooooooo	AS in configuration, update or download
	Flashing red	o o o o o o o	Module incorrectly assigned or internal error
	Alternating green – red – OFF	oo oo oo oo oo	Lamp test active (indicator type priority)
	No indicator		No power supply

## Pulse counters (CI with DI)

At the digital inputs, counter inputs of potential-free contacts, opto-couplers or transistors with an open collector can be connected. The maximum pulse frequency may be up to 10 Hz. To ensure that switching contacts are recorded correctly, a debounce time of 5 ms is planned. Pulses can be captured on falling, rising or both switches. The minimum pulse time should be four times the debounce time.

## Digital inputs

Number of inputs	16
Type of inputs	Potential-free contacts with ground connection Opto-coupler Transistor (open collector)
Pulse counter	≤ 10 Hz (100 ms scan rate)
Pulse status	> 4 ms
Protection against external voltage	±30 V/24 V~ (without destruction)
Max. output current	1.2 mA (source) with respect to ground
Scan rate	100 ms

The binary information is connected between one of the input terminals and the ground. The module applies a voltage of approximately +13 V to the terminal. If a contact is open, this corresponds to an INACTIVE state (bit = 0). If a contact is closed, there is an ACTIVE state (bit = 1) and 0 V is applied, giving a current of approximately 1 mA. Short-term changes (default 33 ms) between the station queries are saved briefly and processed at the next cycle.

Every input can be defined individually as an alarm or a status through software parameter setting. With a local indicating unit (e.g. modu630 accessory) the digital inputs can be displayed.

## Digital outputs

Number of outputs	16
Type of outputs	Digital, transistor open collector switched to ground
Digital output	24 V=, 0 mA up to 100 mA (sink)
Length of connecting cable	≤ 30 m
Processing cycle	100 ms

The open collector outputs (OCs) can be supplied with a power supply of max. 24 V =; the signals are grounded. The plant devices are connected via screw terminals; this may only take place when the system is disconnected from the electrical supply.

All open collector outputs are equipped with protective switches.

When connecting relays with integrated protection (e.g. freewheeling diode), you must ensure that the polarity is correct.

Real feedback is only possible via digital inputs.

If it is mandatory to comply with the European standard (EN 61000 6 2), the connecting cables for the digital open collector outputs (DO-OC) must not be longer than 30 metres.

Defined switching statuses in the event of a module defect are guaranteed by an independent internal cut-off facility. This prevents the outputs from flickering.

The open collector outputs adopt the defined status "0" (Off) when the power supply/communication on the I/O bus is interrupted or when the AS power supply fails.

### Channel and terminal assignment

Description modu571	Channel	Schematic	Terminals	
			DI / DO	GND
Digital input/output Transistor (open collector)	0	od0	1	
	1	od1	2	3
	2	od2	4	5
	3	od3	6	7
	4	od4	8	9
	5	od5	10	
	6	od6	11	
	7	od7	12	
	8	od8	13	
	9	od9	14	
	10	od10	15	16
	11	od11	17	18
	12	od12	19	20
	13	od13	21	22
	14	od14	23	
	15	od15	24	

### Connection of local operating unit

The I/O module can be complemented with local operating and indicating units (LOI). A unit can be installed and removed during operation (hot-pluggable) without affecting functions of the AS or I/O module. For modu571, the following operating and indicating units can be used:

- EY-LO630F001: 16 LED indicators
- EY-LO650F001: 6 switches (automatic mode "A", 0-I) with LED indicators
- EY-LO650F002: 3 switches (automatic mode "A", 0-I-II) with LED indicators

The function corresponds to the standard EN ISO 16484-2:2004 for local override and indicating units.

Detailed information about the actuation function and LED indicator can be found in the PDS 92.081 for EY-LO 6\*\*.

If an incompatible unit is connected, this status is indicated by the flashing of all LEDs (red and yellow); there is no risk of the I/O module being destroyed.



#### Note

Before inserting an indicating and operating unit, all switch positions (AUTO) must be checked to ensure that no undesired switching statuses are active. When the unit is removed, all outputs are operated with the automatic statuses of the I/O module.

In accordance with the standard, the local override and indicating units allow restricted operation of system components without involvement of the AS planned for the application.

Outputs in manual position may change their status briefly when the user program is downloading. The local operating unit can be used to actuate the channels 0...5 in the AS directly even without a user application (CASE Engine).



### Disposal

When disposing of the product, observe the currently applicable local laws.


More information on materials can be found in the Declaration on materials and the environment for this product.

### Accessories


EY-LO630F001	Single unit used for indication of the data points of the modu571 I/O or modu525 AS		
	16 LEDs	LED indication, bi-colour, green/red (freely configurable for Event/Alarm)	

<b>EY-LO650F001</b>	Single unit used for operation and indication of the data points of the modu571 I/O or modu525 AS			
	<table border="1"> <tr> <td><b>4 LEDs</b></td> <td>LED indication, bi-colour, green/red (freely configurable for Event/Alarm)</td> </tr> <tr> <td><b>6 switches with LED indicator</b></td> <td>Level Auto-0-I green indication Manual position indication yellow</td> </tr> </table>		<b>4 LEDs</b>	LED indication, bi-colour, green/red (freely configurable for Event/Alarm)
<b>4 LEDs</b>	LED indication, bi-colour, green/red (freely configurable for Event/Alarm)			
<b>6 switches with LED indicator</b>	Level Auto-0-I green indication Manual position indication yellow			
<b>EY-LO650F002</b>	Single unit used for indication of the data points of the modu570 I/O or modu525 AS			
	<table border="1"> <tr> <td><b>4 LEDs</b></td> <td>LED indication, bi-colour, green/red (freely configurable for Event/Alarm)</td> </tr> <tr> <td><b>3 switches with LED indicator</b></td> <td>Level Auto-0-I-II green indication Manual position indication yellow</td> </tr> </table>		<b>4 LEDs</b>	LED indication, bi-colour, green/red (freely configurable for Event/Alarm)
<b>4 LEDs</b>	LED indication, bi-colour, green/red (freely configurable for Event/Alarm)			
<b>3 switches with LED indicator</b>	Level Auto-0-I-II green indication Manual position indication yellow			

**Connection diagram**

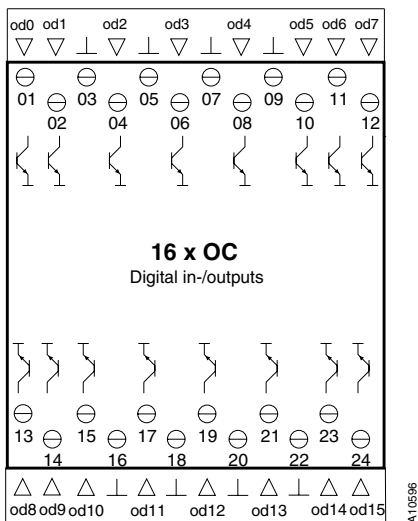

**Dimension drawing**

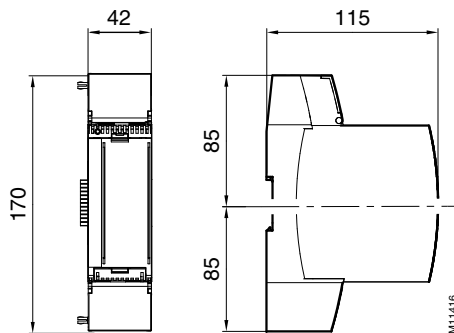

Fr. Sauter AG  
 Im Surinam 55  
 CH-4016 Basel  
 Tel. +41 61 - 695 55 55  
 www.sauter-controls.com